



Main view



Main view

System Status: Standby

Active Faults: No

System Pressure: 25 bar

Section Release

- Main View
- Event Log
- System Status
- Configuration

Section Release

Section Release

Panel Status: Standby

M1 MAIN ENGINE PS	M4 EMERGENCY GENERATOR	Main View
M2 MAIN ENGINE SP	M5 AUX ENGINE	Automatic Release ON/OFF
M3 DIESEL GENERATOR		Mute

System pressure: 25bar
Pump Unit: Standby
Automatic Release Requet: ON

Alarms

Help



Alarms



Active alarms

2010-10-23, 13:18 Panel Fault	Main View
2010-10-23, 13:18 Hi-Fog Activatd	Scroll up
2010-10-23, 13:18 Control System ON	Scroll down
	Mute
	Help

Event log

Event log

- 2010-10-23, 13:18 Hi-Fog Activated
- 2010-10-23, 13:18 Out Of Water
- 2010-10-23, 13:18 Fire Detection System ON (FDS)

Main View

Scroll up

Scroll down

Transfer to UBS

Help

Transfer to USB

Transfer log to USB

Main View


Transferring log to USB, please wait!

Transfer progress:

33% Completed

Cancel

Help

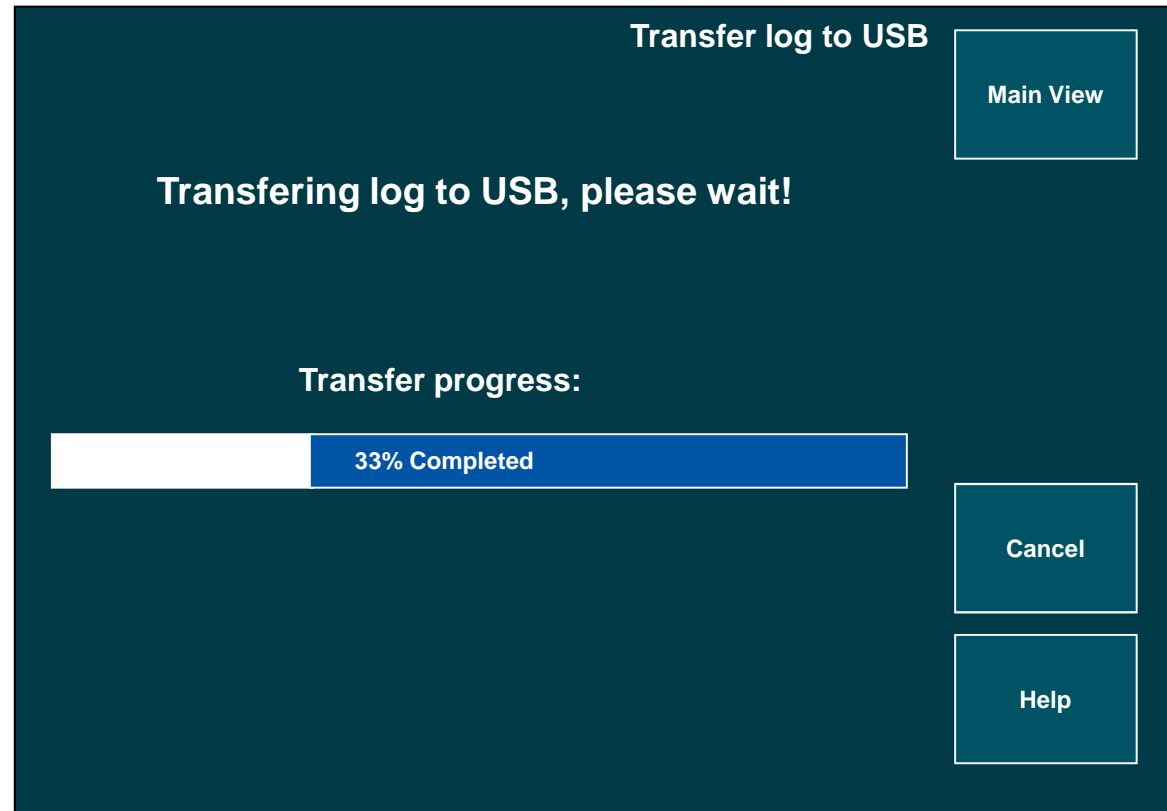



Help



Help

Out Of Water

Pump Unit is out of water. Make sure that the feed water valve is completely open and reset the alarm if still active.

If alarm doesn't disappear even if the valve seems to be completely open, the failure is in ball valve limit switch or its control circuit. Contact Marioff after sales for further help. Please notice that only certified electrician or Marioff service engineer is allowed to inspect electrical circuits.

aftersales@marioff.fi Tel. +358 9 1234456


Main View

Page up


Page down

Back

Status

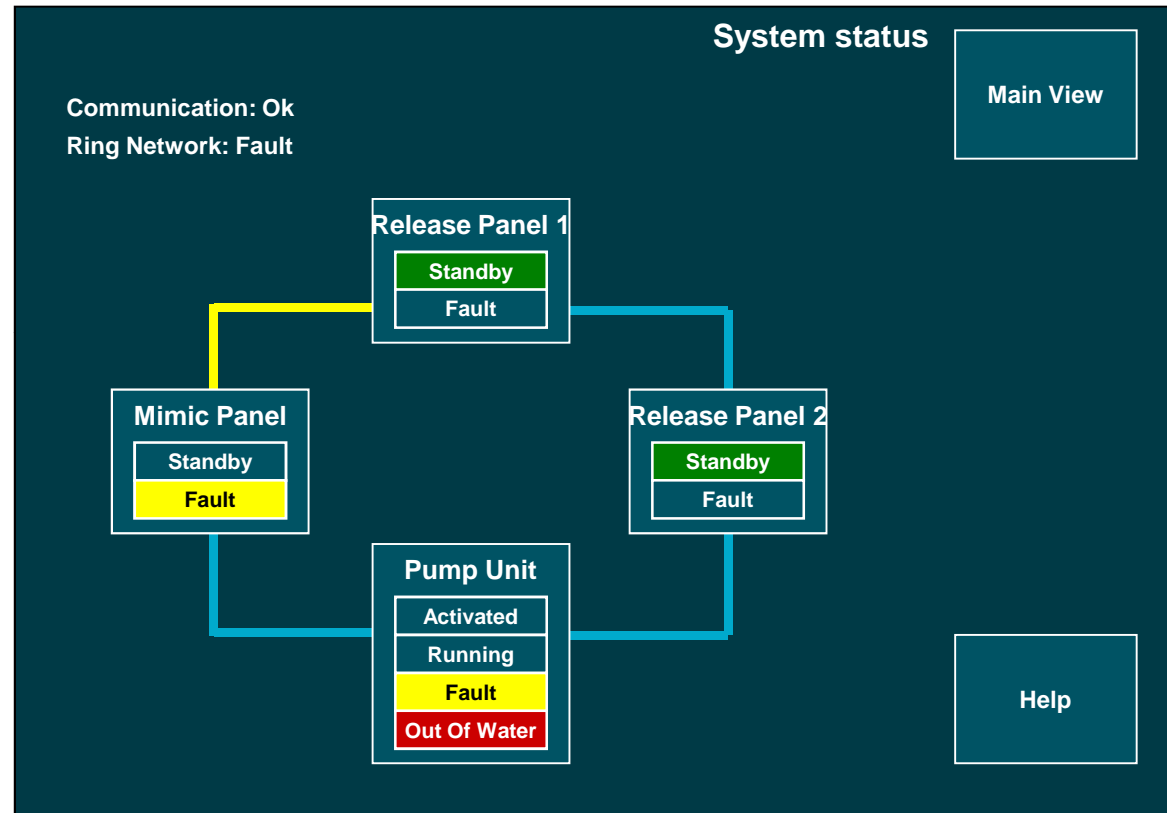

System configuration

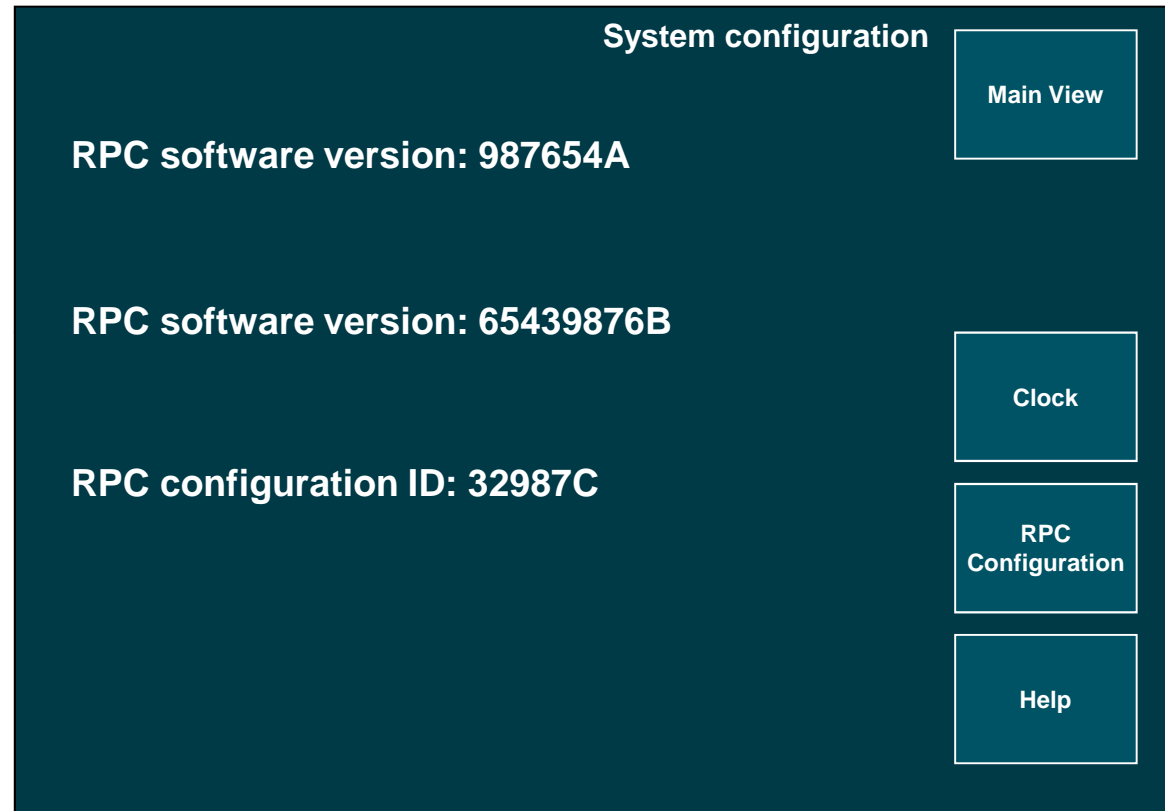

The screenshot shows a dark teal interface titled "System configuration". On the left, three lines of text are displayed: "RPC software version: 987654A", "RPC software version: 65439876B", and "RPC configuration ID: 32987C". On the right side, there is a vertical stack of four buttons: "Main View", "Clock", "RPC Configuration", and "Help".



System clock



System clock

Set clock: HH:MM

Set date: DD:MM:YYYY

Back

Next

Increase

Decrease

Set

RPC configuration

RPC configuration

Warning!

You are about to download new configuration to the Release Panel.
Please insert your USB device.

This operation will disable fire fighting until it's finished. Are you sure?

Main View

No

Yes



RPC configuration validation



RPC configuration validation

**Validating configuration file. Do not remove
USB device!**

**Please perform power reset when
configuration is ready.**